

Information Sheet # 08

EPA Emissions Standards for NON - Emergency Standby Diesel Generator Sets

Your Reliable Guide for Generator Maintenance

1.0 Introduction



The US Environmental Protection Agency (EPA) issued its final exhaust emission regulations for New Source Performance Standards (NSPS) in 2010 for the above, which took effect on January 1, 2011. (See table 1.)

This Information Sheet discusses the regulations for NON - emergency standby generator sets.

EPA began to enforce limitations on exhaust emissions for off-highway diesel engines in 1966 and in 2006 for stationary diesel generator sets. These 'progressive' regulations (called Tier levels) became more stringent over the intervening years and have had a major effect in substantially lowering the levels of nitrogen oxide (NOx), carbon monoxide (CO), particulate matter (PM) and non-methane hydrocarbons (NMHC). (Continued over)

Horse Power	TABLE 1. TIERS 1 - 4 NONROAD EMISSIONS STANDARDS																					
<11																						
>11 - <25																						
>25 - <50																						
>50 - <75																						
>75 - <100																						
>100 - <175																						
>175 - <300																						
>300 - <600																						
>600 - <750																						
>750																						
Year	1996	1997	1998	1999	2000	2001	2002	2003	2004	2005	2006	2007	2008	2009	2010	2011	2012	2013	2014	2015	2016	2017

i = interim Tier 1 Tier 2 Tier 3 Tier 3 flexibility Tier 4i Tier 4i Flexibility Tier 4 Final

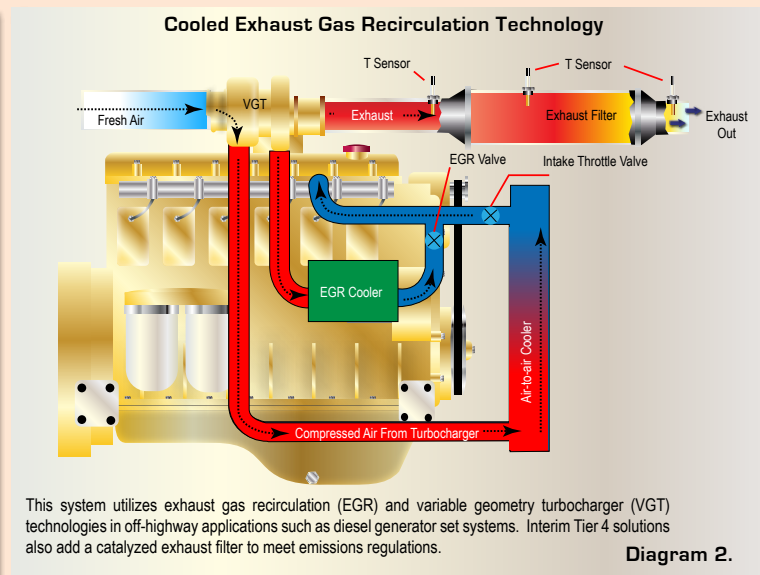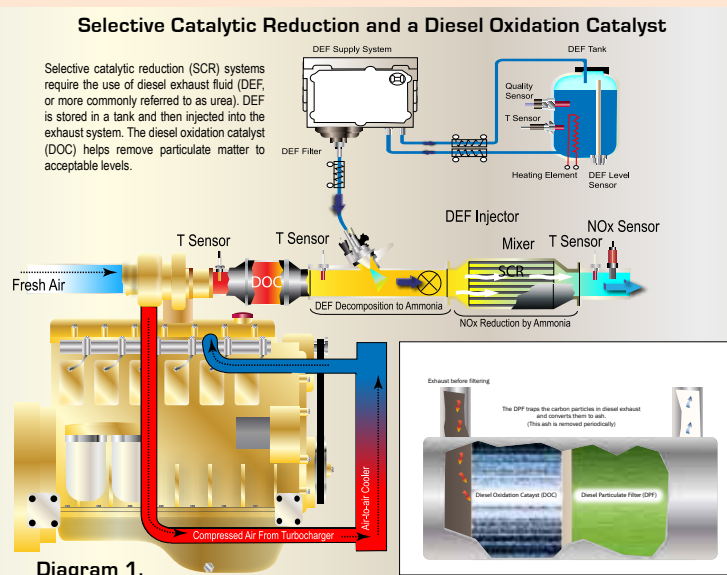

To fulfill our commitment to be the leading supplier in the power generation industry, the Loftin Equipment and Bay City Electric Works teams ensure they are always up-to-date with the current power industry standards as well as industry trends. As a service, our **Information Sheets** are circulated on a regular basis to existing and potential power customers to maintain their awareness of changes and developments in standards, codes and technology within the power industry.

The installation information provided in this information sheet is informational in nature only and should not be considered the advice of a properly licensed and qualified electrician or used in place of a detailed review of the applicable National Electric Codes, NFPA 99/110 and local codes. Specific questions about how this information may affect any particular situation should be addressed to a licensed and qualified engineer and/or electrician.

By the time that Tier 4 Final regulations are introduced in 2013 and 2014, the NOx and PM levels from diesel exhaust will have been reduced by 99%. These Tier levels were introduced and 'staggered' over this time frame dependent on the generator diesel engine horsepower (or metric mechanical kW equivalent) and NOT the kW output per the generator nameplate.

2.0 Achieving Tier 4 Interim and Tier 4 Final Emissions Regulations

Diesel engine manufacturers were able to achieve compliance to Tier 2 and 3 by in-engine or internal design changes (e.g. combustion chamber, increased high pressure (up to 20,000 psi) common rail fuel injection, valve timing, cooled exhaust gas recirculation, four-valve cylinder heads, advanced variable geometry or waste-gated turbochargers, compound or staged turbochargers, air-to-air after-cooling, and electronic engine controls).

In order to meet the higher Tier 4 Interim and Tier 4 Final emission regulations, manufacturers will have had to resort to additional devices such as cooled exhaust gas recirculation (ERG) to lower the nitrogen dioxide (NOx)) levels and add 'external' aids for the after-treatment of the exhaust - such as exhaust filters to reduce particulate matter (PM). When these systems are added to today's clean diesel engine, the result can achieve NOx and PM emission reduction improvements of more than 99%.

3.0 Typical Non – Emergency Standby Power (ESP) applications requiring the use of Tier 4 Interim & Tier 4 final diesel engines

- Non-emergency diesel standby units – permanently installed or operating at the same location for 12 consecutive months
- Prime Power applications – where the set is the primary source of electrical power
- Load management, operation as part of a financial arrangement (e.g. Interruptible rates) or peak shaving applications – including and set paralleled with the local utility and used for containment programs. These may also be used for emergency standby duty, the secondary use for load management disqualifies them for Tier 4 Interim and Tier 4 Final exemptions
- Rental and other mobile generator sets – including temporary power used on construction sites, any seasonal utility load peak shaving, special events or any other temporary power application.

For any non-emergency diesel applications, Tier 4 regulations are to be introduced in two steps – Tier 4 Interim in 2011 and Tier 4 Final for small non-emergency gensets in 2013, and finally all non-emergency generator sets by 2015.

4.0 Exhaust after-treatment technologies

For Tier 4 Interim and Tier 4 Final, most diesel engines will further require selective catalytic reduction (SCR) to control NOx and diesel particulate filters (DPF) to capture the remaining PM. Some engine models will be capable of meeting Tier 4 Final regulations for PM without the use of a DPF. Others may use ERG combined with a DPF on certain platforms in order to reduce NOx rather than a SCR.

- **Selective Catalytic Reduction (SCR).** This system works by combining ammonia in the form of urea or diesel emissions fluid (DEF) and passing the mixture over a catalyst. The resultant exhaust contains the harmless element of nitrogen, water vapor and carbon dioxide. Approximately one gallon of DEF is required for every 20 gallons of diesel fuel burnt. The SCR will be introduced to meet ESP Tier 4 Interim regulations in California and certain non-attainment areas, and for all non-emergency generator applications with regard for location. *(See drawing 1 overleaf)*
- **Diesel Particulate Filters (DPF).** These devices trap and incinerate soot particles (PM). They will not be required to meet Tier 4 Interim but will be needed in most power nodes to operate in conjunction with SCR to meet Tier 4 Final. The DPF has a mechanical filter to trap these soot particles after the partial oxidization by the catalyst. At certain intervals during operation, these trapped particles are incinerated. Periodically, any inert ash will have to be removed from the DPF. It is expected that a combined DPF and SCR device in 2014 and 2015 to comply with Tier 4 Final regulations for ESP sets in California and certain non-attainment areas, and for all non-emergency applications regardless of location. *(See drawing 1 overleaf)*
- **Exhaust Gas Recirculation (EGR).** This technology is used by certain manufacturers to reduce the NOx in diesel exhaust. EGR operates by the recirculation of a small amount of the cooled exhaust gas back into the combustion chamber. This will reduce the combustion temperature thus effectively lowering the NOx and ERG equipped models will not need SCR after-treatment. On the other hand, EGR increases the particulate emissions, so a DPF will be required for both Tier 4 Interim and Tier 4 Final regulations. *(See drawing 2 overleaf)*

The above engineering changes for Tier 6 Interim and Tier 4 Final will mean that the engine will have to cope with a higher heat rejection level and so larger and/or more expensive radiators will be required. This may well increase the physical size of an enclosure or canopy of the generator set - as does the placement of any such after-treatment exhaust devices inside the canopy. This will be particularly noticeable on sound attenuated units.

Note! Always consultate your local generator distributor/dealer for the latest regulations that will apply to your particular installation.

5.0 Useful sites - www.epa.gov



www.bcew.com
service@bcew.com

Corporate Headquarters
 13625 Danielson Street
 Poway, CA 92064
 Ph: 866.938.8200 Toll Free
 Fx: 619.938.8202

Inland Empire Facility
 766 South Gifford Avenue
 San Bernardino, CA 92408
 Ph: 866.938.8200 Toll Free
 Fx: 909.890.9258



www.loftinequip.com
service@loftinequip.com

Corporate Headquarters
 2122 E. Highland Suite #425
 Phoenix, AZ 85016
 Ph: 602.272.9466
 Fx: 602.272.7582
 Ph: 800.437.4376 Toll Free

Parts & Service- Phoenix
 12 N. 45th Avenue
 Phoenix, AZ 85043
 Ph: 602.272.9466
 Fx: 602.272.7582
 Ph: 800.437.4376 Toll Free

San Antonio/Austin
 1241 University City Blvd.
 Universal City, TX 78148
 Ph: 210.881.1623
 Fx: 210.881.2143
 Ph: 866.441.0375 Toll Free

Dallas/Fort Worth
 5204 Bear Creek Court
 Irving, TX 75061
 Ph: 469.359.6040
 Fx: 972.790.5754

Las Vegas
 6280 S. Valley View Blvd.
 Suite 718
 Las Vegas, NV 89118
 Ph: 702.399.7595
 Fx: 702.399.7475

Houston
 6113 Brittmoore Rd.
 Houston, TX 77041
 Ph: 281.310.6858
 Fx: 281.310.6865
 Ph: 800.822.3078 Toll Free