

Information Sheet # 78
Cold Climate Considerations for Generator Sets

*Your Reliable Guide for
Generator Maintenance*

1.0 Introduction:


When emergency/standby generator systems are to be installed in an area that will experience cold temperatures, it is important to take into account several factors that can effect operation in cold climates.

This information sheet discusses factors encountered for generator systems operating in cold temperatures and recommends to the system designer certain accessories that should be included in their specification.

2.0 Main areas of a generator system effected by cold temperatures:

An operator has to consider operationally how the cold effects the generator system when stationary and during operation. The principal issue for a stationary set is how the cold will prevent normal starting of the generator system. Once the set is running the operator has to consider what accessories or functions could be effected by the cold to cause any of the generator set equipment to shutdown. *(Continued over)*

Key Specifications to Ensure Easier Starting in Cold Climates

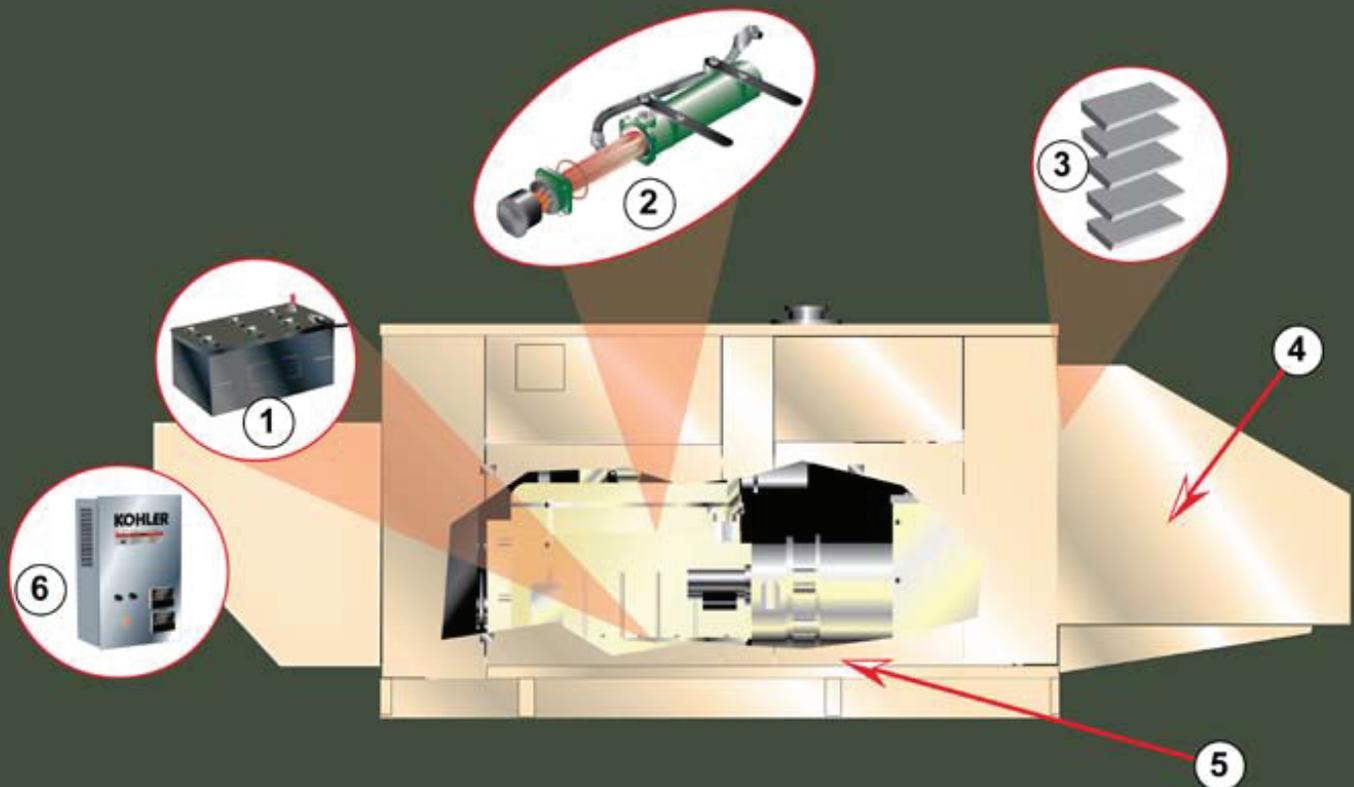

1 - Battery Heater Pads

2 - Engine Block Heater

3 - Motorized Louvers

4 - Snow Protective Cowling

5 - Fuel Treatment

6 - Auto Battery Chargers

To fulfill our commitment to be the leading supplier in the power generation industry, the Loftin Equipment and Bay City Electric Works teams ensures they are always up-to-date with the current power industry standards as well as industry trends. As a service, our **Information Sheets** are circulated on a regular basis to existing and potential power customers to maintain their awareness of changes and developments in standards, codes and technology within the power industry.

The installation information provided in this information sheet is informational in nature only and should not be considered the advice of a properly licensed and qualified electrician or used in place of a detailed review of the applicable National Electric Codes, NFPA 99/110 and local codes. Specific questions about how this information may affect any particular situation should be addressed to a licensed and qualified engineer and/or electrician.

3.0 Components of generator system where cold temperatures will impede starting:

The components of a generator system that have to be maintained at a minimum temperature or be specified for cold temperatures to ensure starting in cold ambients are.

Engine coolant mixture - A stationary generator set system within a few hours of shutdown will be at the same ambient temperature as its surroundings. The operator should consult with the dealer for recommended coolant mixture.

Engine coolant temperature - The most common method to maintain coolant at an optimum level for easy starting, above 60° F (16° C), is the fitting of block heaters. Block heaters are fitted to generator systems installed outside and inside.

Block heaters are considered a normal accessory for standby generators. The size is dependent on the ambient conditions for the specific installation site. A rule of thumb is that typical block heater will require 1 to 2 hours to bring the engine up to temperature for rapid starting. Most block heaters are connected to a constant electrical supply or have a thermostat included to maintain and regulate coolant temperature. It is important to automatically disconnect the heater when the engine start sequence is initiated.

Several types of block heater are available:

Tank-style heaters - The most common in practice and mounted on or close to the engine with wattage up to 5000 watts.

Freeze plug heater - Replaces a core or freeze plug in the engine block and has an element inserted in the water jacket channels of the engine block. The coolant is circulated by the thermo siphon effect.

Lower radiator hose heater - Normally only utilized on small engines for generator sets under 15kW.

Lubricating oil - Thermostatically controlled electric heaters can be mounted in the engine lubricating-oil system to maintain the oil temperature at a level for rapid starting. As for block heaters, this device must be automatically disconnected as soon as the engine start cycle is initiated.

Batteries - The ampere hour capacity of the lead acid battery, commonly used on generator systems, reduces as the ambient temperature falls. A fully charged battery with all its cranking power available at 80°F, will only have about 40% available power at 0°F.

A weak battery may not crank the starter motor fast enough or long enough to start a cold engine.

Actions for batteries are:

Correct sizing - Consult with the dealer regarding the required ampere hour capacity for the ambient temperature.

Charging - The battery should be maintained in a fully charged state, preferably with automatic battery chargers.

Battery heater pads and blankets - The NFPA 110 standard for standby or emergency generators calls for such devices to be used, where conditions make them necessary.

4.0 Components of generator system where cold temperatures can impede operation:

In cold ambient conditions normal running operation of a generator set system can be effected. The following areas of the system should be considered to ensure reliable running while the set is in operation:

Fuel system - Incorrect fueling will impact starting and the ability of the generator set to continue in operation. Diesel fuels are susceptible to gelling (waxing) in below freezing conditions. Running sets will shut down if the ambient conditions worsen after start.

The following actions should be taken to ensure continued fuel supply to the system in cold ambients:

Winter grade diesel fuel - It is important to use winter grade diesel fuel (often called No. 1), in lieu of the summer fuel (No. 2), where temperatures dictate. This winter grade fuel is lighter, less oily and has less lubricating qualities than No. 2 fuel.

Fuel conditioners - A number of manufacturers can supply anti-gelling additives for use on site to treat the fuel and prevent crystals forming at low temperatures, where conditions are extreme. Paraffin crystals or molecules precipitate from the fuel and form a waxy substance. This can block the fuel filter (s) which will restrict the fuel flow to the fuel pump and injectors, and need to be dispersed.

Conditioners maintain these crystals evenly throughout the fuel which helps to prevent wax clogging the fuel system. There are certain brands of conditioners that will lower the pour point of the fuel by up to 40%. Some fuel conditioners are freeze depressants that lower the freeze point of any water in the fuel, which helps to prevent damage caused by ice forming in the fuel lines.

Ventilation - A major factor associated with operation in cold climates, is precipitation in the form of ice and snow. Generator sets require adequate ventilation for combustion and cooling. Where accumulation of ice and snow are expected, the set should be installed in a suitable enclosure or building with adequate apertures for inlet and exhaust air ventilation.

In locations where there is blowing snow and ice, moveable louvers can seal the apertures when the generator set is stationary. The moveable louvers should open in a positive manner. Motorized louvers are preferred over those that open with fan pressure because sleet and snow can render them inoperative in a relatively short period.

Air Cleaner Icing - To avoid ice building up in the air cleaner, the air requires only enough heat to be above the dew point. In cold conditions, ensure the inlet air location of the air cleaner is located in an area that receives recirculated warm engine room air.



Bay City Main Office - San Diego
13625 Danielson Street
Poway, CA 92064
Toll Free: 866.938.8200
Fax: 619.938.8202
service@bcw.com

Greater LA Area Sales and Service Center
860 Lawson Street
City of Industry, CA 91748
Toll Free: 866.938.8200
Fax: 619.938.8216

San Francisco Area Service Center
322 Lindbergh Avenue
Livermore, CA 94551
Toll Free: 866.938.8200
Fax: 619.938.8216
www.bcw.com



www.loftinequip.com
service@loftinequip.com

Corporate Headquarters
2111 E. Highland Ave. Ste. 255
Phoenix, AZ 85016
Phone: (602) 272-9466
Fx: 602.272.7582
Toll-Free: 800-437-4376

Parts & Service- Phoenix
12 N. 45th Ave.
Phoenix, AZ 85043
Phone: (602) 272-9466
Toll-Free: 800-437-4376

San Antonio/Austin
2121 Universal City Blvd.
Universal City, TX 78148
Phone: (210) 881-1623 (San Antonio)
Phone: (512) 464-1890 (Austin)
Fax: (210) 881-2143
Toll-free: 866-441-0375

Dallas/Fort Worth
5204 Bear Creek Court
Irving, TX 75061
Phone: (214) 237-4566
Fax: (469) 359-60188

Houston
6113 Brittmoore Rd.
Houston, TX 77041
Phone: (281) 310-6858
Toll-Free: 800-822-3078
Fax: (281) 310-6865

Las Vegas
701 N. Green Valley Pkwy. STE 200
Henderson, NV 89074
Phone: (702) 399-7595
Fax: (702) 399-7457